


BLUE-BOOK “LITE”



Common Erosion and Sediment Control Standards For Code Municipal Enforcement Officers and Inspectors

For a complete copy of the Blue Book, please visit the NYS DEC website at:
<http://www.dec.ny.gov/chemical/29066.html>

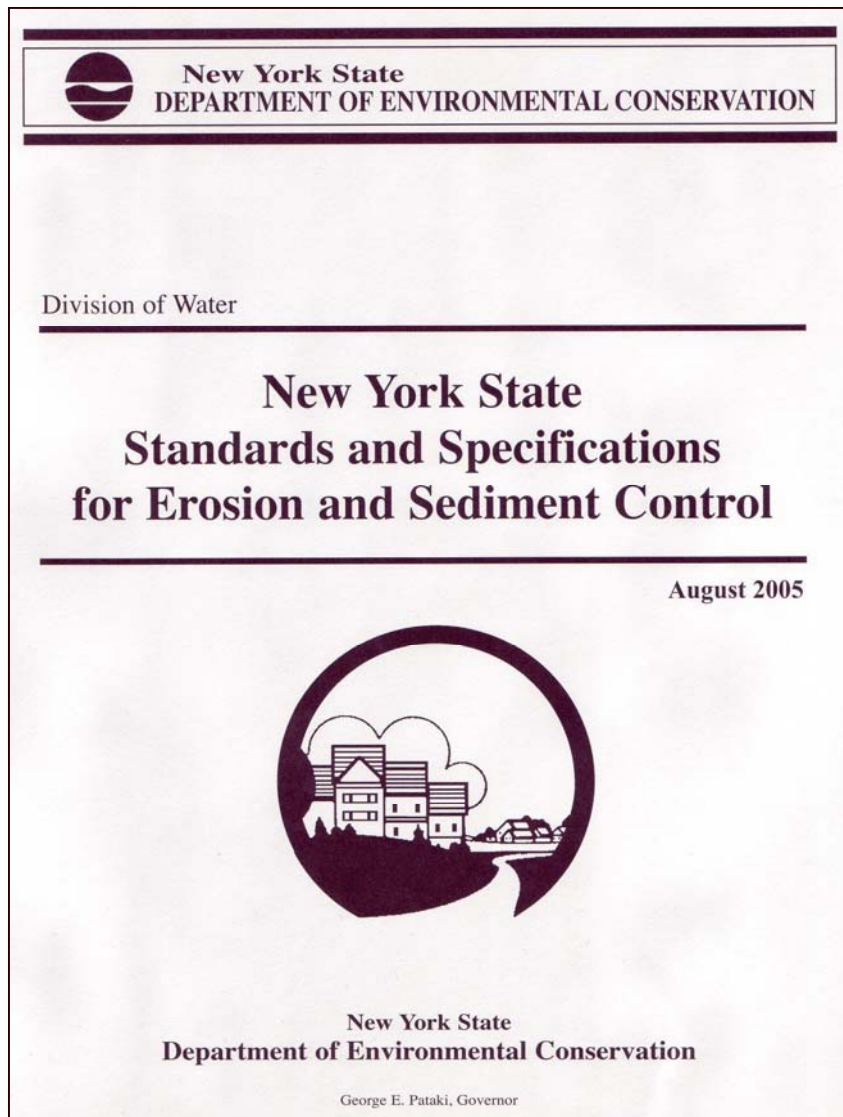

For use at *Construction Site Stormwater Inspections for Code Enforcement Officers - Part 2*

NYS Department of Environmental Conservation Endorsed Stormwater Training

NYS Department of State Code Enforcement Educational Program #49-5653

June 2007

Blue-Book “Lite”

Table of Contents

The *Blue Book "Lite"* is a compilation of the more commonly used erosion and sediment control practices from the unabridged *New York State Standards and Specifications for Erosion and Sediment Control*, the so-called “Blue Book.” These were compiled for training purposes because construction stormwater site inspectors need to be familiar with the standards and specifications from the “Blue Book,” and these would be more frequently encountered during inspections. The numbers in the Table (left column) represent the pages where the content (right column) would be found in the “Blue Book.” Go to <http://www.dec.ny.gov/chemical/29066.html> to view or download the full document on the New York State Department of Environmental Conservation website.

1.1	INTRODUCTION (1st of 2 pages, i.e., in the above cited document)
1.3	BASIC PRINCIPLES OF EROSION AND SEDIMENT CONTROL (1 page)
2.5 & 2.7	STEPS IN THE SELECTION AND DESIGN OF CONTROL MEASURES (1st and 3rd of 9 pages)
3.5 & 3.6	PERMANENT CRITICAL AREA PLANTINGS (1st 2 of 4 pages)
3.29 & 3.30	MULCHING (1st 2 of 4 pages)
3.33 & 3.34	STABILIZATION WITH SOD (both pages)
5A.17 & 5A.18	STRAW BALE DIKE (both pages)
5A.19 & 5A.21	SILT FENCE (1st and 3rd of 4 pages)
5A.23 & 5A.24	CHECK DAM (both pages)
5A.27 & 5A.28	STORM DRAIN INLET PROTECTION (1st 2 of 6 pages)
5A.35 & 5A.36	SEDIMENT TRAP (1st 2 of 12 pages)
5A.49	SEDIMENT BASIN (1st of 26 pages)
5A.87	DUST CONTROL (1st of 2 pages)
5A.75 & 5A.76	STABILIZED CONSTRUCTION ENTRANCE (both pages)
5B.11 & 5B.13	GRASSED WATERWAY (1st and 3rd of 6 pages)
5B.15 & 5B.17	LINED WATERWAY OR OUTLET (1st and 3rd of 4 pages)

The following sections from the August 2005 “Blue Book” prepared by:

Introduction and Sections 1, 2 and 5 -
Donald W. Lake, Jr., P.E., CPESC, CPSWQ
Engineering Specialist
New York State Soil & Water Conservation Committee

Section3 -
Frederick B. Gaffney
Former Conservation Agronomist
USDA - Natural Resources Conservation Service
Syracuse, New York

and

John A. Dickerson
Plant Materials Specialist
USDA - Natural Resources Conservation Service
Syracuse, New York

INTRODUCTION

Purpose

The purpose of this manual is to provide minimum standards and specifications for meeting criteria set forth by the New York State Department of Environmental Conservation (NYS DEC) for stormwater discharges associated with construction activity. The standards and specifications provide criteria on minimizing erosion and sediment impacts from construction activity involving soil disturbance. They show how to use soil, water, plants, and products to protect the quality of our environment. These standards and specifications were developed in cooperation with the USDA Natural Resources Conservation Service, New York State Soil and Water Conservation Committee (NYSSWCC), NYS DEC and other state and local agencies for use by planners, design engineers, developers, contractors, landscape architects, property owners, and resource managers. Proper use of these standards will protect the waters of the state from sediment loads during runoff events.

Scope and Authority

The standards and specifications apply to lands within New York State where housing, industrial, institutional, recreational, or highway construction, and other land disturbances are occurring or imminent. They are statewide in scope and, in some cases, are somewhat generalized due to variations in climate, topography, geology, soils, and plant requirements. Feasible ways to minimize erosion and sedimentation are varied and complex. Following these standards and specifications is presumed to be in compliance with the SPDES general permit for construction activities. Alternative methods may be explored on a case specific basis and shall be discussed with NYS DEC regional staff.

The Environmental Protection Agency delegated stormwater responsibility for the National Pollutant Discharge Elimination System (NPDES) Permit to New York on October 1, 1992. New York State issued its first General Permit for stormwater discharges from construction activities on August 1, 1993. This was issued pursuant to Article 17, Titles 7, 8 and Article 70 of Environmental Conservation Law. At a minimum, an erosion and sediment control plan must be prepared for any construction activity that disturbs one or more acres.

Erosion and Sediment Hazards Associated with Development

Many people may be adversely affected by development on relatively small areas of land. Uncontrolled erosion and sediment from these areas may cause considerable economic damage to individuals and society in general.

Stream pollution and damages to public facilities and private homes are examples. Hazards associated with land disturbance include:

1. A large increase of soil exposed to erosion from wind and water;
2. Increased water runoff, soil movement, sediment accumulation and peak flows caused by:
 - a. Removal of plant cover;
 - b. A decrease in the area of soil which can absorb water because of construction of streets, buildings, sidewalks, and parking lots;
 - c. Changes in drainage areas caused by grading operations, diversions, and streets;
 - d. Changes in volume and duration of water concentrations caused by altering steepness, distance, and surface roughness;
 - e. Soil compaction by heavy equipment, which can reduce the water intake of soils as much as 90 percent of the original rate; and,
 - f. Prolonged exposure of unprotected sites and disturbed areas to poor weather conditions.
3. Altering the groundwater regime that may adversely affect drainage systems, slope stability, survival of existing vegetation and establishment of new plants;
4. Exposing subsurface materials that are too rocky, too acid, or otherwise unfavorable for establishing plants;
5. Obstructing stream flow with new buildings, dikes, and land fills;
6. Improper timing and sequencing of construction and development activities; and,
7. Abandonment of sites before completion of construction.

How to Use This Manual

The standards and specifications listed in this manual have been developed over time to reduce the impact of soil loss from construction sites to receiving water bodies and adjacent properties. This manual provides designers with details on how to plan a site for erosion and sediment control and how to select, size, and design specific practices to meet these resource protection objectives. The appendices at the end of this manual contain additional information as guidance for site plan design and review, construction implementation, and site inspection. Review and inspection checklists are provided to aid planners and designers in meeting the standards requirements.

BASIC PRINCIPLES OF EROSION AND SEDIMENT CONTROL

The Erosion and Sedimentation Processes

The standards, specifications, and planning guidelines presented in this document are intended to be utilized when development activities change the natural topography and vegetative cover of an area. Erosion and sediment control plans must be designed and constructed to minimize erosion and sediment problems associated with soil disturbance. To understand how erosion and sediment rates are increased requires an understanding of the processes themselves.

Soil erosion is the removal of soil by water, wind, ice, or gravity. This document deals primarily with the types of soil erosion caused by rainfall and surface runoff. Raindrops strike the soil surface at a velocity of approximately 25-30 feet per second and can cause splash erosion. Raindrop erosion causes particles of soil to be detached from the soil mass and splash into the air. After the soil particles are dislodged, they can be transported by surface runoff, which results when the soil becomes too saturated to absorb falling rain or when the rain falls at an intensity greater than the rate at which the water can enter the soil. Scouring of the exposed soil surface by runoff can cause further erosion. Runoff can become concentrated into rivulets or well-defined channels up to several inches deep. This advanced stage is called rill erosion. If rills and grooves remain unrepaired, they may develop into gullies when more concentrated runoff flows downslope.

Sediment deposition occurs when the rate of surface flow is insufficient for the transport of soil particles. The heavier particles, such as sand and gravel, transport less readily than the lighter silt and clay particles. Previously deposited sediment may be suspended by runoff from another storm and transported farther downslope. In this way, sediment is carried intermittently downstream from its upland point of origin.

Factors That Influence Erosion

The erosion potential of a site is determined by five factors; soil erodibility, vegetative cover, topography, climate, and season. Although the factors are interrelated as determinants of erosion potential, they are discussed separately for easy understanding.

1. **Soil Erodibility** – The vulnerability of a soil to erosion is known as erodibility. The soil structure, texture, and percentage of organic matter influence its erodibility. The most erodible soils generally contain high proportions of silt and very fine sand. The presence of clay or organic matter tends to decrease soil erodibility. Clays are sticky and tend to bind soil particles together. Organic matter helps to maintain stable soil structure (aggregates).

2. **Vegetative Cover** – Vegetation protects soil from the erosive forces of raindrop impact and runoff scour in several ways. Vegetation (top growth) shields the soil surface from raindrop impact while the root mass holds soil particles in place. Grass buffer strips can be used to filter sediment from the surface runoff. Grasses also slow the velocity of runoff, and help maintain the infiltration capacity of a soil. The establishment and maintenance of vegetation are the most important factors in minimizing erosion during development.

3. **Topography** – Slope length and steepness greatly influence both the volume and velocity of surface runoff. Long slopes deliver more runoff to the base of slopes and steep slopes increase runoff velocity. Both conditions enhance the potential for erosion to occur.

4. **Climate** – Climate also affects erosion potential in an area. Rainfall characteristics such as frequency, intensity, and duration directly influence the amount of runoff that is generated. As the frequency of rainfall increases, water has less chance to drain through the soil between storms. The soil will remain saturated for longer periods of time and stormwater runoff volume may be potentially greater. Therefore, erosion risks are high where rainfall is frequent, intense, or lengthy.

5. **Season** – Seasonal variation in temperature and rainfall defines periods of high erosion potential during the year. High erosion potential may exist in the spring when the surface soil first thaws and the ground underneath remains frozen. A low intensity rainfall may cause substantial erosion because the frozen subsoil prevents water infiltration. In addition, the erosion potential increases during the summer months due to more frequent, high intensity rainfall.

STEPS IN THE SELECTION AND DESIGN OF CONTROL MEASURES

The following text relates to the planning flow charts on pages 2.6, 2.7 and 2.8.

In the erosion and sediment control process, site designs must be prepared to address erosion control and then sediment control. Erosion control is accomplished by controlling runoff and then stabilizing soil. After erosion control has been planned, sediment control can then be developed.

Step 1: Identify Control Methods—Three basic methods are used to control soil movement on construction sites: runoff control, soil stabilization, and sediment control. **CONTROLLING EROSION SHALL BE THE FIRST LINE OF DEFENSE.** Runoff control and soil stabilization can be used to control erosion. Controlling erosion is very effective for small-disturbed areas such as single lots or small areas of a disturbance.

Sediment control may be necessary on large developments where mass grading is planned, where it is harder or impractical to control erosion, and where sediment particles are relatively large. A minimum of cost for erosion and sediment control is usually accomplished by using a combination of vegetative and structural erosion control and sedimentation control measures.

Step 2: Identify Resources and Potential Problem Areas—Resources need to be identified prior to initiating an ESC plan. These resources include, but are not limited to, receiving waters, tributaries to public water supplies, beaches and other concentrated recreational areas, wetlands, trees, vegetative buffers, steep slopes and cultural resources. Areas where erosion is to be controlled will usually fall into categories of slopes, graded areas or drainage ways. Slopes include graded rights-of-way, stockpile areas, and all cut or fill slopes. Graded areas include all stripped areas other than slopes. Drainage ways are areas where concentrations of water flow naturally or artificially, and the potential for gully erosion is high. Problem areas where sediment is to be controlled fall into categories of large or small drainage areas. Small areas are usually 1 acre or less while large areas are greater than 1 acre.

Step 3: Identify Required Strategy—The third step in erosion and sediment control planning is to follow the planning matrix from the problem area to the strategy that can be taken to solve the problem. Strategies can be used individually or in combination. For example, if there is a cut slope to be protected from erosion, the strategies may be to protect the ground surface, divert water from the slope, or

shorten it. Any combination of these strategies can be used. If no rainfall except that which falls on the slope has the potential to cause erosion, and if the slope is relatively short, protecting the soil surface is often all that is required to solve the problem.


Step 4: Identify Control Measure Group—Once required strategies are identified, the planning flow chart leads to the group or groups of control measures that will accomplish one strategy. Control measures within each group have similar purpose, scope, application, design, criteria, standard plans, and construction specifications. Therefore, any measure within a group may solve the problem in question.

Step 5: Design Specific Control Measures—The final step in erosion and sediment control planning is accomplished by completing final design. This involves applying any control measure within a group to solve the specific erosion and sediment control problem. From descriptions given to the right of each control measure in the ESC planning matrix (Table 2.1), the one measure which is most economical, practical, efficient, and adaptable to the site should be chosen.

Step 6: Winter Operations—If construction activities continue during winter, access points should be enlarged and stabilized to provide for snow stockpiling. In addition, a snow management plan should be prepared with adequate storage and control of meltwater. A minimum 25 foot buffer shall be maintained from perimeter controls such as silt fence. In high resource protection areas, silt fence shall be replaced with perimeter dikes, swales, or other practices resistant to the forces of snow loads. Keep drainage structures open and free of snow and ice dams. Inspection and maintenance are necessary to ensure the function of these practices during runoff events.

Once the specific control measure has been selected, the plan key symbol given in the flow chart must be placed on the erosion and sediment control site plan to show where the control measure will be used. Standardized design, plan, and construction specification sheets must then be completed for each control measure. This completes the planning for erosion control and soil stabilization as part of the total natural resource plan.

Figure 2.2
Planning Flow Chart—Soil Stabilization

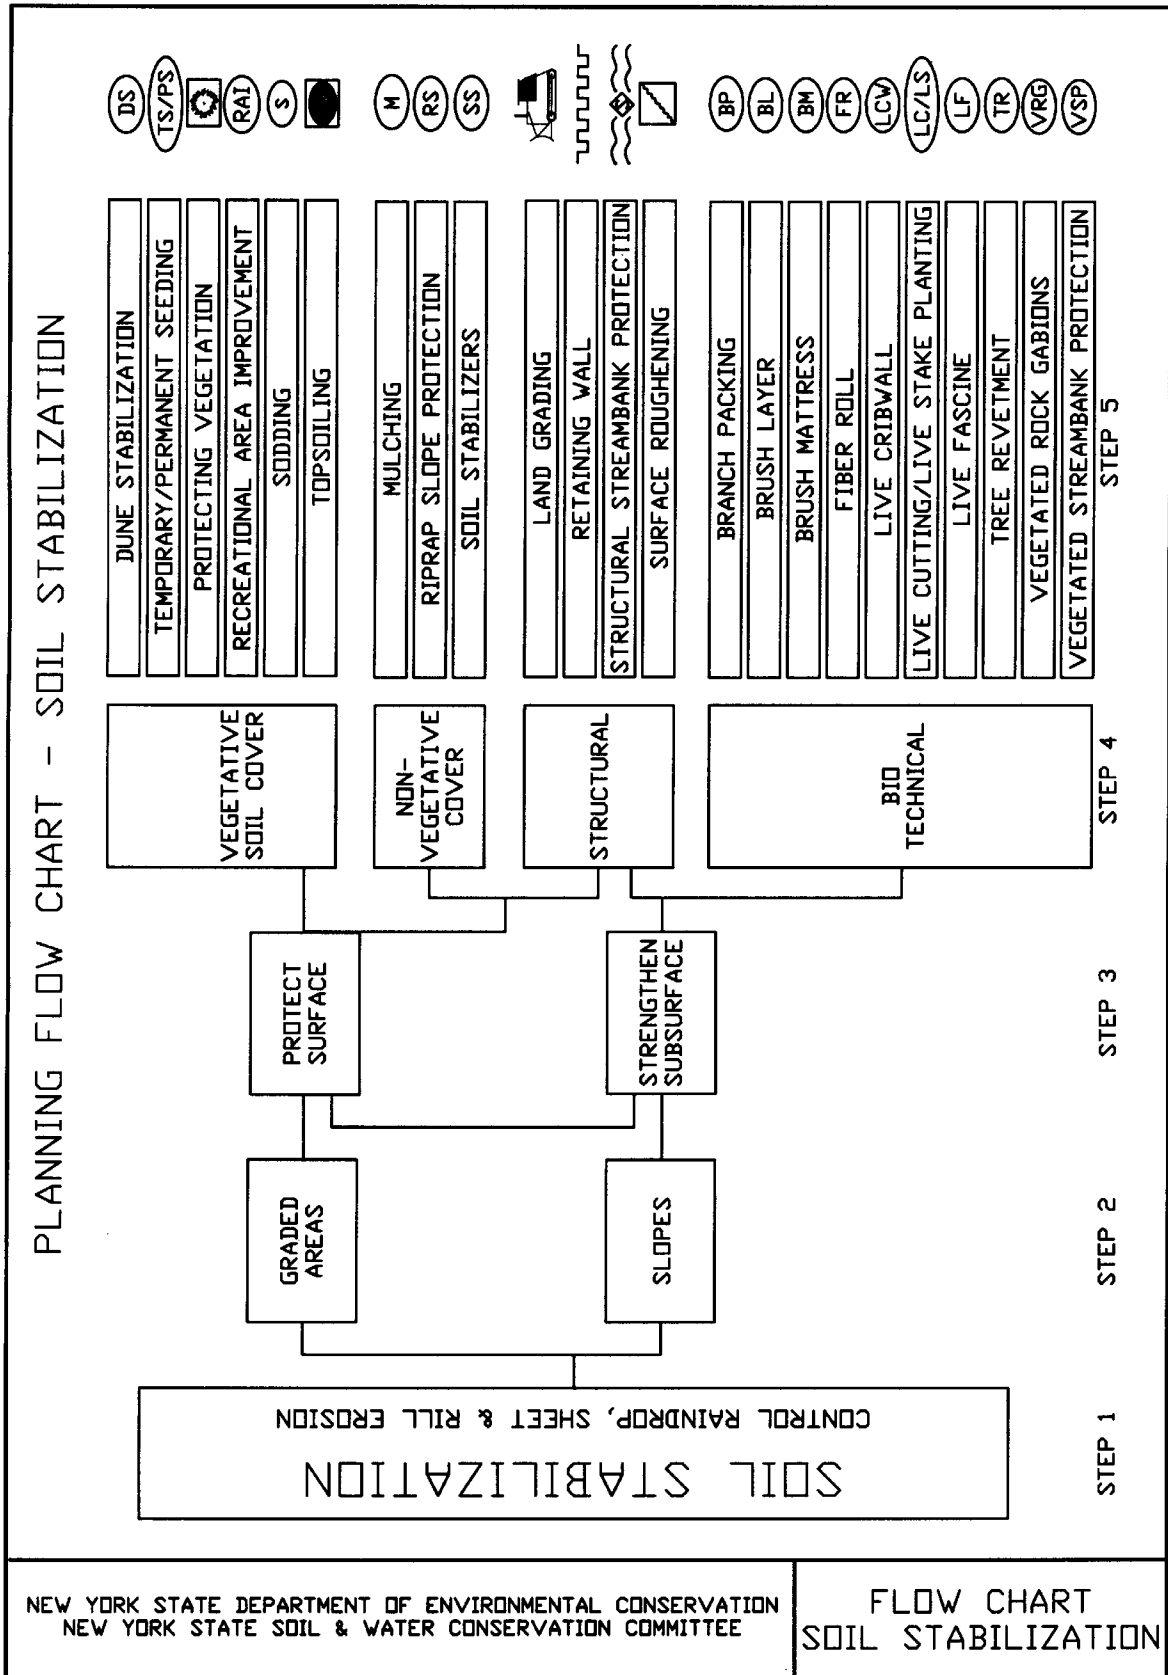

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

FLOW CHART
SOIL STABILIZATION

STANDARD AND SPECIFICATIONS FOR PERMANENT CRITICAL AREA PLANTINGS



Definition

Establishing grasses with other forbs and/or shrubs to provide perennial vegetative cover on disturbed, denuded, slopes subject to erosion.

Purpose

To reduce erosion and sediment transport.

Conditions Where Practice Applies

This practice applies to all disturbed areas void of, or having insufficient, cover to prevent erosion and sediment transport. See additional standards for special situations such as sand dunes and sand and gravel pits.

Criteria

All water control measures will be installed as needed prior to final grading and seedbed preparation. Any severely compacted sections will require chiseling or disking to provide an adequate rooting zone, to a minimum depth of 12". The seedbed must be prepared to allow good soil to seed contact, with the soil not too soft and not too compact. Adequate soil moisture must be present to accomplish this. If surface is powder dry or sticky wet, postpone operations until moisture changes to a favorable condition. If seeding is accomplished within 24 hours of final grading, additional scarification is generally not needed, especially on ditch or stream banks. Remove all stones and other debris from the surface that are greater than 4 inches, or that will interfere with future mowing or maintenance.

Soil amendments should be incorporated into the upper 2 inches of soil when feasible. **The soil should be tested to determine the amounts of amendments needed.** Apply ground agricultural limestone to attain a pH of 6.0 in the upper 2 inches of soil. If soil must be fertilized before

results of a soil test can be obtained to determine fertilizer needs, apply commercial fertilizer at 600 lbs. per acre of 5-10-10 or equivalent. If manure is used, apply a quantity to meet the nutrients of the above fertilizer. This requires an appropriate manure analysis prior to applying to the site. Do not use manure on sites to be planted with birdsfoot trefoil or in the path of concentrated water flow.

Seed mixtures may vary depending on location within the state and time of seeding. Generally, warm season grasses should only be seeded during early spring, April to May. These grasses are primarily used for vegetating excessively drained sands and gravels. See Standard and Specification for Sand and Gravel Mine Reclamation. Other grasses may be seeded any time of the year when the soil is not frozen and is workable. When legumes such as birdsfoot trefoil are included, spring seedings are preferred. See Table 3.1 "Permanent Critical Area Planting Mixture Recommendations" for additional seed mixtures.

General Seed Mix:

¹ add inoculant immediately prior to seeding

	<u>Variety</u>	<u>lbs./acre</u>	<u>lbs/1000 sq. ft.</u>
Birdsfoot trefoil ¹ <u>OR</u>	Empire/Pardee	8 ²	0.20
Common white clover ¹	Common	8	0.20
<u>PLUS</u>			
Tall fescue	KY-31/Rebel	20	0.45
<u>PLUS</u>			
Redtop <u>OR</u>	Common	2	0.05
Ryegrass (perennial)	Pennfine/Linn	5	0.10

² Mix 4 lbs each of Empire and Pardee OR 4 lbs of Birdsfoot and 4 lbs white clover per acre.

Time of Seeding: The optimum timing for the general seed mixture is early spring. Permanent seedings may be made any time of year if properly mulched and adequate moisture is provided. Late June through early August is not a good time to seed, but may facilitate covering the land without additional disturbance if construction is completed. Portions of the seeding may fail due to drought and heat. These areas may need reseeding in late summer/fall or the following spring.

Method of seeding: Broadcasting, drilling, cultipack type

seeding, or hydroseeding are acceptable methods. Proper soil to seed contact is key to successful seedings.

Mulching: Mulching is essential to obtain a uniform stand of seeded plants. Optimum benefits of mulching new seedings are obtained with the use of small grain straw applied at a rate of 2 tons per acre, and anchored with a netting or tackifier. See the mulch standard and specification for choices and requirements.

Irrigation: Watering may be essential to establish a new seeding when a drought condition occurs shortly after a new seeding emerges. Irrigation is a specialized practice and care must be taken not to exceed the application rate for the soil or subsoil. When disconnecting irrigation pipe, be sure pipes are drained in a safe manor, not creating an erosion concern.

STANDARD AND SPECIFICATIONS FOR MULCHING



Definition

Applying coarse plant residue or chips, or other suitable materials, to cover the soil surface.

Purpose

The primary purpose is to provide initial erosion control while a seeding or shrub planting is establishing. Mulch will conserve moisture and modify the surface soil temperature and reduce fluctuation of both. Mulch will prevent soil surface crusting and aid in weed control. Mulch is also used alone for temporary stabilization in non-growing months.

Conditions Where Practice Applies

On soils subject to erosion and on new seedlings and shrub plantings. Mulch is useful on soils with low infiltration rates by retarding runoff.

Criteria

Site preparation prior to mulching requires the installation of necessary erosion control or water management practices and drainage systems.

Slope, grade and smooth the site to fit needs of selected mulch products.

Remove all undesirable stones and other debris to meet the needs of the anticipated land use and maintenance required.

Apply mulch after soil amendments and planting is accomplished or simultaneously if hydroseeding is used.

Select appropriate mulch material and application rate or material needs. Determine local availability.

Select appropriate mulch anchoring material.

NOTE: The best combination for grass/legume establishment is straw (cereal grain) mulch applied at 2 ton/acre (90 lbs./1000sq.ft.) and anchored with wood fiber mulch (hydromulch) at 500 – 750 lbs./acre (11 – 17 lbs./1000 sq. ft.). The wood fiber mulch must be applied through a hydroseeder immediately after mulching.

Table 3.7
Guide to Mulch Materials, Rates, and Uses

Mulch Material	Quality Standards	per 1000 Sq. Ft.	per Acre	Depth of Application	Remarks
Wood chips or shavings	Air-dried. Free of objectionable coarse material	500-900 lbs.	10-20 tons	2-7"	Used primarily around shrub and tree plantings and recreation trails to inhibit weed competition. Resistant to wind blowing. Decomposes slowly.
Wood fiber cellulose (partly digested wood fibers)	Made from natural wood usually with green dye and dispersing agent	50 lbs.	2,000 lbs.	—	Apply with hydromulcher. No tie down required. Less erosion control provided than 2 tons of hay or straw.
Gravel, Crushed Stone or Slag	Washed; Size 2B or 3A—1 1/2"	9 cu. yds.	405 cu. yds.	3"	Excellent mulch for short slopes and around plants and ornamentals. Use 2B where subject to traffic. (Approximately 2,000 lbs./cu. yd.). Frequently used over filter fabric for better weed control.
Hay or Straw	Air-dried; free of undesirable seeds & coarse materials	90-100 lbs. 2-3 bales	2 tons (100-120 bales)	cover about 90% surface	Use small grain straw where mulch is maintained for more than three months. Subject to wind blowing unless anchored. Most commonly used mulching material. Provides the best micro-environment for germinating seeds.
Jute twisted yarn	Undyed, unbleached plain weave. Warp 78 ends/yd., Weft 41 ends/yd. 60-90 lbs./roll	48" x 50 yds. or 48" x 75 yds.	—	—	Use without additional mulch. Tie down as per manufacturers specifications. Good for center line of concentrated water flow.
Excelsior wood fiber mats	Interlocking web of excelsior fibers with photodegradable plastic netting	8" x 100" 2-sided plastic, 48" x 180" 1-sided plastic	—	—	Use without additional mulch. Excellent for seeding establishment. Tie down as per manufacturers specifications. Approximately 72 lbs./roll for excelsior with plastic on both sides. Use two sided plastic for centerline of waterways.
Compost	Up to 3" pieces, moderately to highly stable	3-9 cu. yds.	134-402 cu. yds.	1-3"	Coarser textured mulches may be more effective in reducing weed growth and wind erosion.
Straw or coconut fiber, or combination	Photodegradable plastic net on one or two sides	Most are 6.5 ft. x 3.5 ft.	81 rolls	—	Designed to tolerate higher velocity water flow, centerlines of waterways, 60 sq. yds. per roll.

STANDARD AND SPECIFICATIONS FOR STABILIZATION WITH SOD



Definition

Stabilizing silt producing areas by establishing long term stands of grass with sod.

Purpose

To stabilize the soil; reduce damage from sediment and runoff to downstream areas; enhance natural beauty.

Conditions Where Practice Applies

On exposed soils that have a potential for causing off site environmental damage where a quick vegetative cover is desired. Moisture, either applied or natural, is essential to success.

Design Criteria

1. Sod shall be bluegrass or a bluegrass/red fescue mixture or a perennial ryegrass for average sites. (CAUTION: Perennial ryegrass has limited cold tolerance and may winter kill.) Use turf type cultivars of tall fescue for shady, droughty, or otherwise more critical areas. For variety selection, contact Cornell Cooperative Extension Turf Specialist.
2. Sod shall be machine cut at a uniform soil thickness of 3/4 inch, plus or minus 1/4 inch. Measurement for thickness shall exclude top growth and thatch.
3. Standard size sections of sod shall be strong enough to support their own weight and retain their size and shape when suspended vertically from a firm grasp on the upper 10 percent of the section.
4. Sod shall be free of weeds and undesirable coarse weedy grasses. Wild native or pasture grass sod shall not be used

unless specified.

5. Sod shall not be harvested or transplanted when moisture content (excessively dry or wet) may adversely affect its survival.
6. Sod shall be harvested, delivered, and installed within a period of 36 hours. Sod not transplanted within this period shall be inspected and approved by the contracting officer or his designated representative prior to its installation.

Site Preparation

Fertilizer and lime application rates shall be determined by soil tests. Under unusual circumstances where there is insufficient time for a complete soil test and the contracting officer agrees, fertilizer and lime materials may be applied in amounts shown in subsection 2 below. Slope land such as to provide good surface water drainage. Avoid depressions or pockets.

1. Prior to sodding, the surface shall be smoothed and cleared of all trash, debris, and of all roots, brush, wire, grade stakes and other objects that would interfere with planting, fertilizing or maintenance operations.
2. **The soil should be tested to determine the amounts of amendments needed.** Where the soil is acid or composed of heavy clays, ground limestone shall be spread to raise the pH to 6.5. If the soil must be fertilized before results of a soil test can be obtained to determine fertilizer needs, apply commercial fertilizer at 20 lbs. of 5-10-10 (or equivalent) and mix into the top 3 inches of soil with the required lime for every 1,000 square feet. Soil should be moist prior to sodding. Arrange for temporary storage of sod to keep it shaded and cool.

Sod Installation

1. For the operation of laying, tamping, and irrigating for any areas, sod shall be completed within eight hours. During periods of excessively high temperature, the soil shall be lightly moistened immediately prior to laying the sod.
2. The first row of sod shall be laid in a straight line with subsequent rows placed parallel to, and tightly wedged against, each other. Lateral joints shall be staggered to promote more uniform growth and strength. Ensure that sod is not stretched or overlapped and that all joints are butted tight in order to prevent voids which would cause air drying of the roots. On sloping areas where erosion may be a problem, sod shall be laid with the long edges parallel to the contour and with staggered joints.

3. Secure the sod by tamping and pegging, or other approved methods. As sodding is completed in any one section, the entire area shall be rolled or tamped to ensure solid contact of roots with the soil surface.

4. Sod shall be watered immediately after rolling or tamping until the underside of the new sod pad and soil surface below the sod are thoroughly wet. Keep sod moist for at least two weeks.

Sod Maintenance

1. In the absence of adequate rainfall, watering shall be performed daily, or as often as deemed necessary by the inspector, during the first week and in sufficient quantities to maintain moist soil to a depth of 4 inches. Watering should be done in the morning. Avoid excessive watering during applications.

2. After the first week, sod shall be watered as necessary to maintain adequate moisture and ensure establishment.

3. The first mowing should not be attempted until sod is firmly rooted. No more than 1/3 of the grass leaf shall be removed by the initial cutting or subsequent cuttings. Grass height shall be maintained between 2 and 3 inches unless

otherwise specified. Avoid heavy mowing equipment for several weeks to prevent rutting.

4. If the soil must be fertilized before results of a soil test can be obtained to determine fertilizer needs, apply fertilizer three to four weeks after sodding, at a rate of 1 pound nitrogen/1,000 sq.ft. Use a complete fertilizer with a 2-1-1 ratio.

5. Weed Control: Target herbicides for weeds present. Consult current Cornell Pest Control Recommendations for Commercial Turfgrass Management or consult the local office of Cornell Cooperative Extension.

6. Disease Control: Consult the local office of the Cornell Cooperative Extension.

Additional References

1. Home Lawns, Establishment and Maintenance, CCE Information Bulletin 185, Revised November 1994. Cornell University, Ithaca, NY.

2. Installing a Sod Lawn. CCE Suffolk County, NY. Thomas Kowalsick February 1994, Revised January 1999. www.cce.cornell.edu/counties/suffolk/grownet

STANDARD AND SPECIFICATIONS FOR STRAW BALE DIKE



Definition

A temporary barrier of straw, or similar material, used to intercept sediment laden runoff from small drainage areas of disturbed soil.

Purpose

The purpose of a bale dike is to reduce runoff velocity and effect deposition of the transported sediment load. Straw bale dikes have an estimated design life of three (3) months.

Conditions Where Practice Applies

The straw bale dike is used where:

1. No other practice is feasible.

2. There is no concentration of water in a channel or other drainage way above the barrier.
3. Erosion would occur in the form of sheet erosion.
4. Length of slope above the straw bale dike does not exceed these limits.

Constructed Slope	Percent Slope	Slope Length (ft.)
2:1	50	25
3:1	33	50
4:1	25	75


Where slope gradient changes through the drainage area, steepness refers to the steepest slope section contributing to the straw bale dike.

The practice may also be used for a single family lot if the slope is less than 15 percent. The contributing drainage areas in this instance shall be less than one quarter of an acre per 100 feet of fence and the length of slope above the dike shall be less than 200 feet.

Design Criteria

The above table is adequate, in general, for a one-inch rainfall event. Larger storms could cause failure of this practice. Use of this practice in sensitive areas for longer than one month should be specifically designed to store expected runoff. All bales shall be placed on the contour with cut edge of bale adhering to the ground. See Figure 5A.7 on page 5A.18 or details.

**Figure 5A.7
Straw Bale Dike**

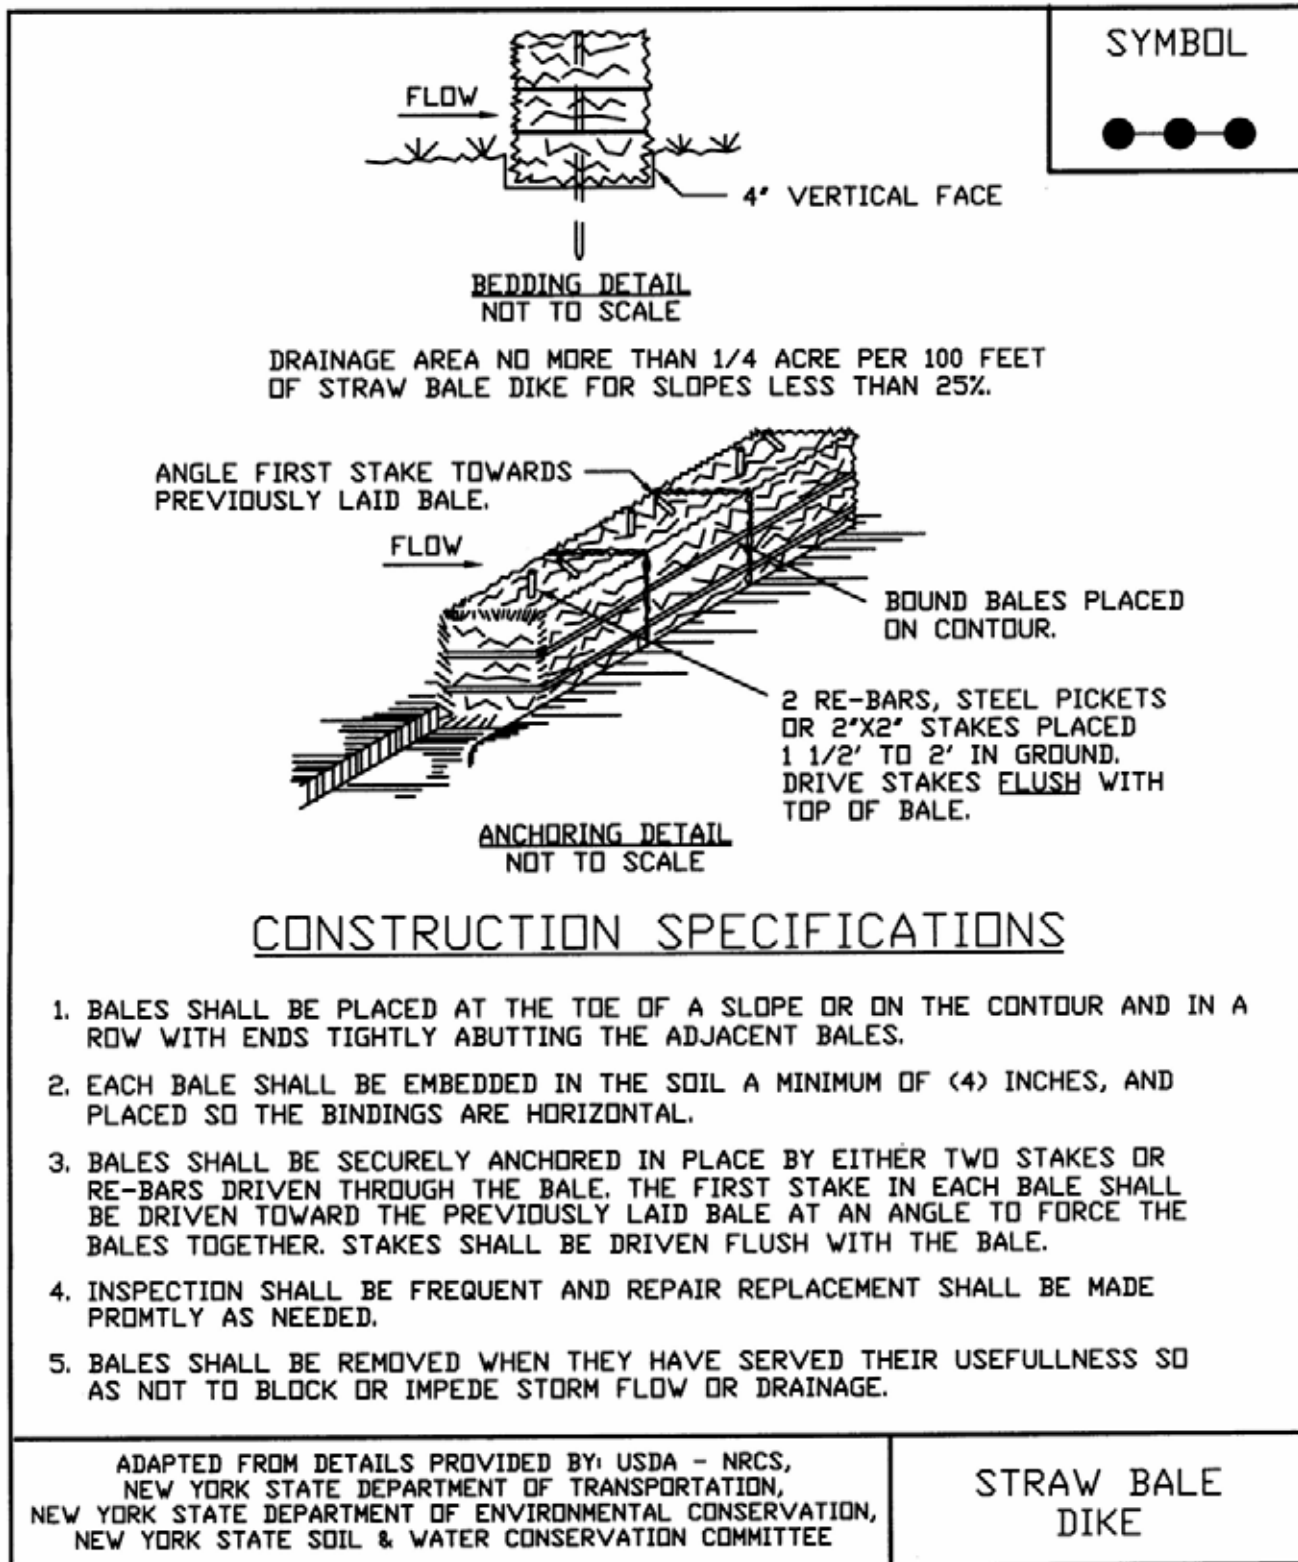

STANDARD AND SPECIFICATIONS FOR SILT FENCE



Definition

A temporary barrier of geotextile fabric installed on the contours across a slope used to intercept sediment laden runoff from small drainage areas of disturbed soil.

Purpose

The purpose of a silt fence is to reduce runoff velocity and effect deposition of transported sediment load. Limits imposed by ultraviolet stability of the fabric will dictate the maximum period the silt fence may be used (approximately one year).

Conditions Where Practice Applies

A silt fence may be used subject to the following conditions:

1. Maximum allowable slope lengths contributing runoff to a silt fence placed on a slope are:

Slope Steepness	Maximum Length (ft.)
2:1	25
3:1	50
4:1	75
5:1 or flatter	100

2. Maximum drainage area for overland flow to a silt fence shall not exceed ¼ acre per 100 feet of fence, with maximum ponding depth of 1.5 feet behind the fence; and
3. Erosion would occur in the form of sheet erosion; and
4. There is no concentration of water flowing to the barrier.

Design Criteria

Design computations are not required for installations of 1 month or less. Longer installation periods should be designed for expected runoff. All silt fences shall be placed as close to the areas as possible, but at least 10 feet from the toe of a slope to allow for maintenance and roll down. The area beyond the fence must be undisturbed or stabilized.

Sensitive areas to be protected by silt fence may need to be reinforced by using heavy wire fencing for added support to prevent collapse.


Where ends of filter cloth come together, they shall be overlapped, folded and stapled to prevent sediment bypass. A detail of the silt fence shall be shown on the plan. See Figure 5A.8 on page 5A.21 for details.

Criteria for Silt Fence Materials

1. Silt Fence Fabric: The fabric shall meet the following specifications unless otherwise approved by the appropriate erosion and sediment control plan approval authority. Such approval shall not constitute statewide acceptance.

Fabric Properties	Minimum Acceptable Value	Test Method
Grab Tensile Strength (lbs)	90	ASTM D1682
Elongation at Failure (%)	50	ASTM D1682

Figure 5A.8
Silt Fence

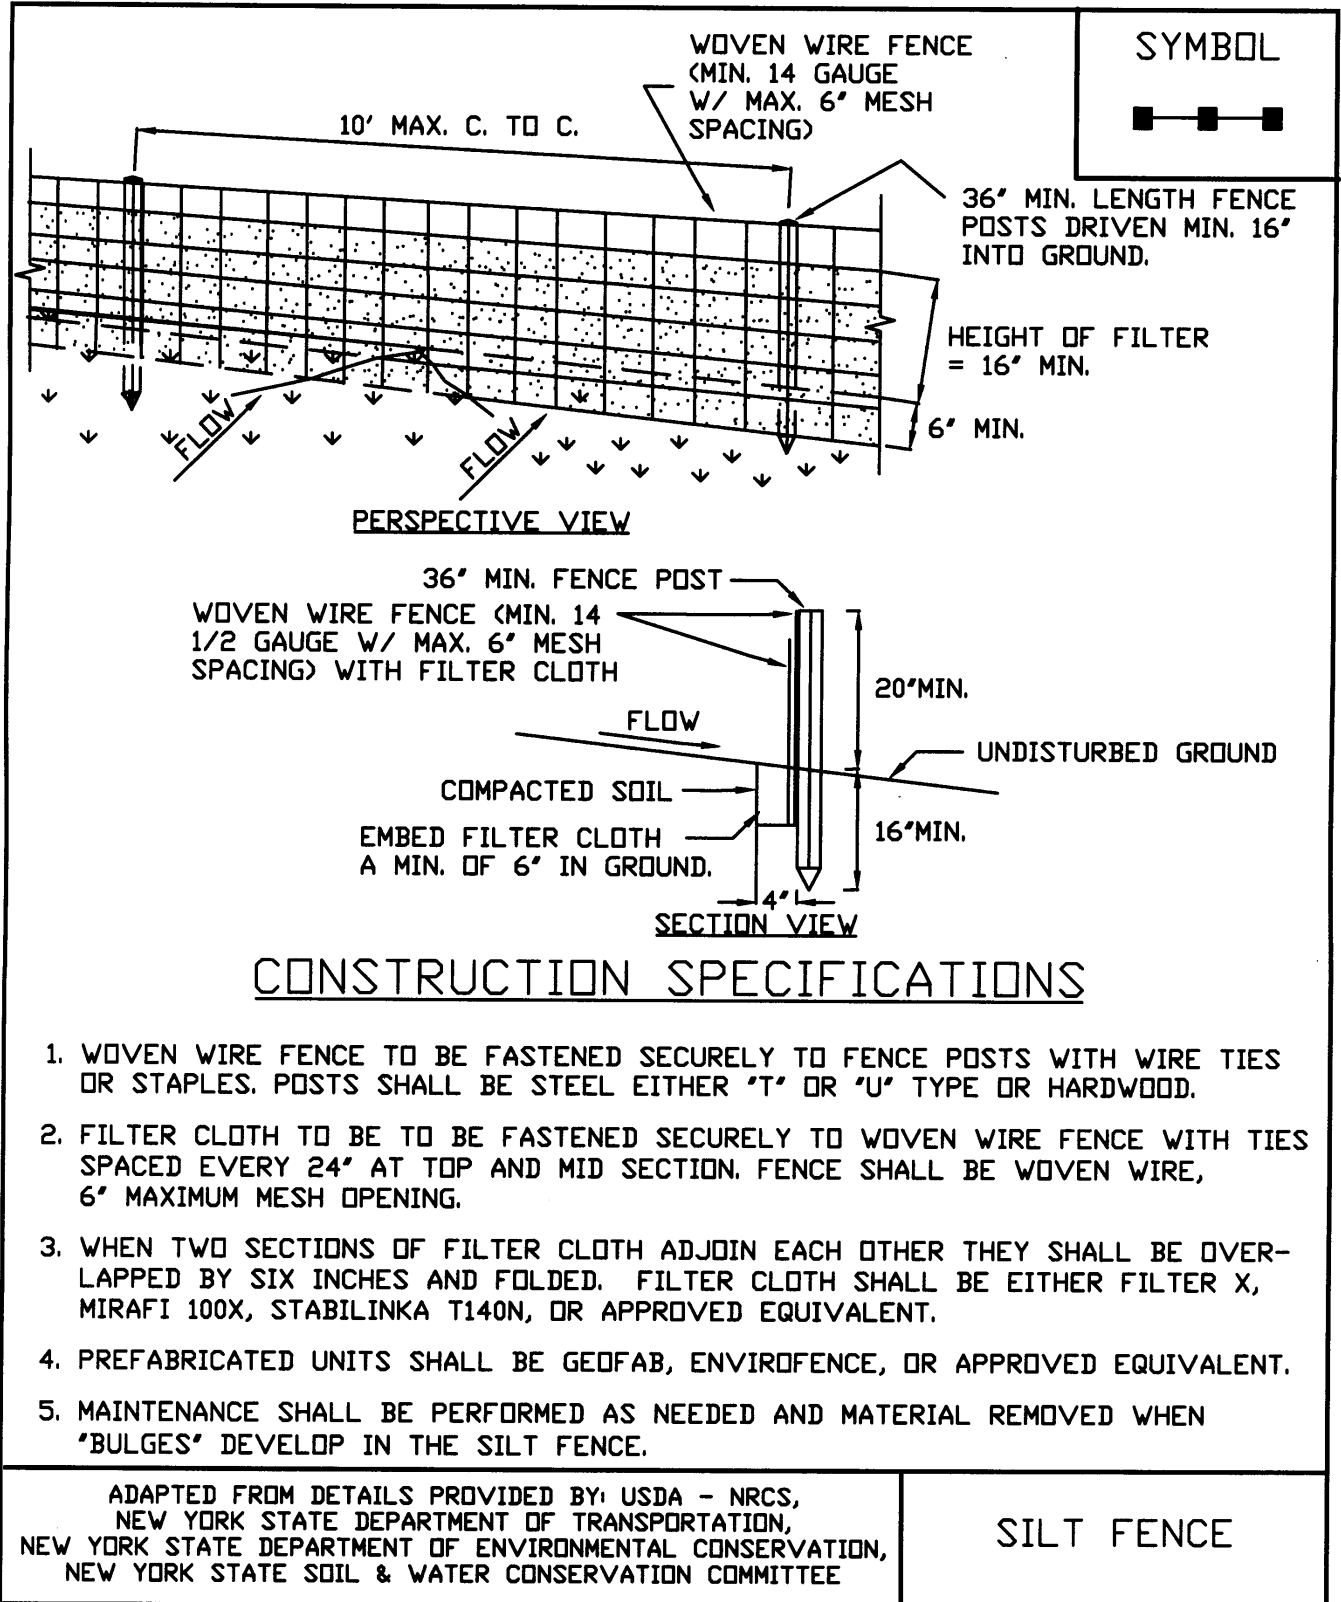

STANDARD AND SPECIFICATIONS FOR CHECK DAM



Definition

Small barriers or dams constructed of stone, bagged sand or gravel, or other durable material across a drainage way.

Purpose

To reduce erosion in a drainage channel by restricting the velocity of flow in the channel.

Condition Where Practice Applies

This practice is used as a temporary or emergency measure to limit erosion by reducing velocities in small open channels that are degrading or subject to erosion and where permanent stabilization is impractical due to short period of usefulness and time constraints of construction.

Design Criteria

Drainage Area: Maximum drainage area above the check dam shall not exceed two (2) acres.

Height: Not greater than 2 feet. Center shall be maintained 9 inches lower than abutments at natural ground elevation.

Side Slopes: Shall be 2:1 or flatter.

Spacing: The check dams shall be spaced as necessary in the channel so that the crest of the downstream dam is at the

elevation of the toe of the upstream dam. This spacing is equal to the height of the check dam divided by the channel slope.

Therefore:

$$S = h/s$$

Where:

S = spacing interval (ft.)

h = height of check dam (ft.)

s = channel slope (ft./ft.)

Example:

For a channel with a 4% slope and 2 ft. high stone check dams, they are spaced as follows:

$$S = \frac{2 \text{ ft.}}{.04 \text{ ft./ft.}} = 50 \text{ ft.}$$

Stone size: Use a well graded stone matrix 2 to 9 inches in size (NYS – DOT Light Stone Fill meets these requirements).

The overflow of the check dams will be stabilized to resist erosion that might be caused by the check dam. See Figure 5A.9 on page 5A.24 for details.


Check dams should be anchored in the channel by a cutoff trench 1.5 ft. wide and 0.5 ft. deep and lined with filter fabric to prevent soil migration.

Maintenance

The check dams should be inspected after each runoff event. Correct all damage immediately. If significant erosion has occurred between structures, a liner of stone or other suitable material should be installed in that portion of the channel.

Remove sediment accumulated behind the dam as needed to allow channel to drain through the stone check dam and prevent large flows from carrying sediment over the dam. Replace stones as needed to maintain the design cross section of the structures.

**Figure 5A.9
Check Dam**

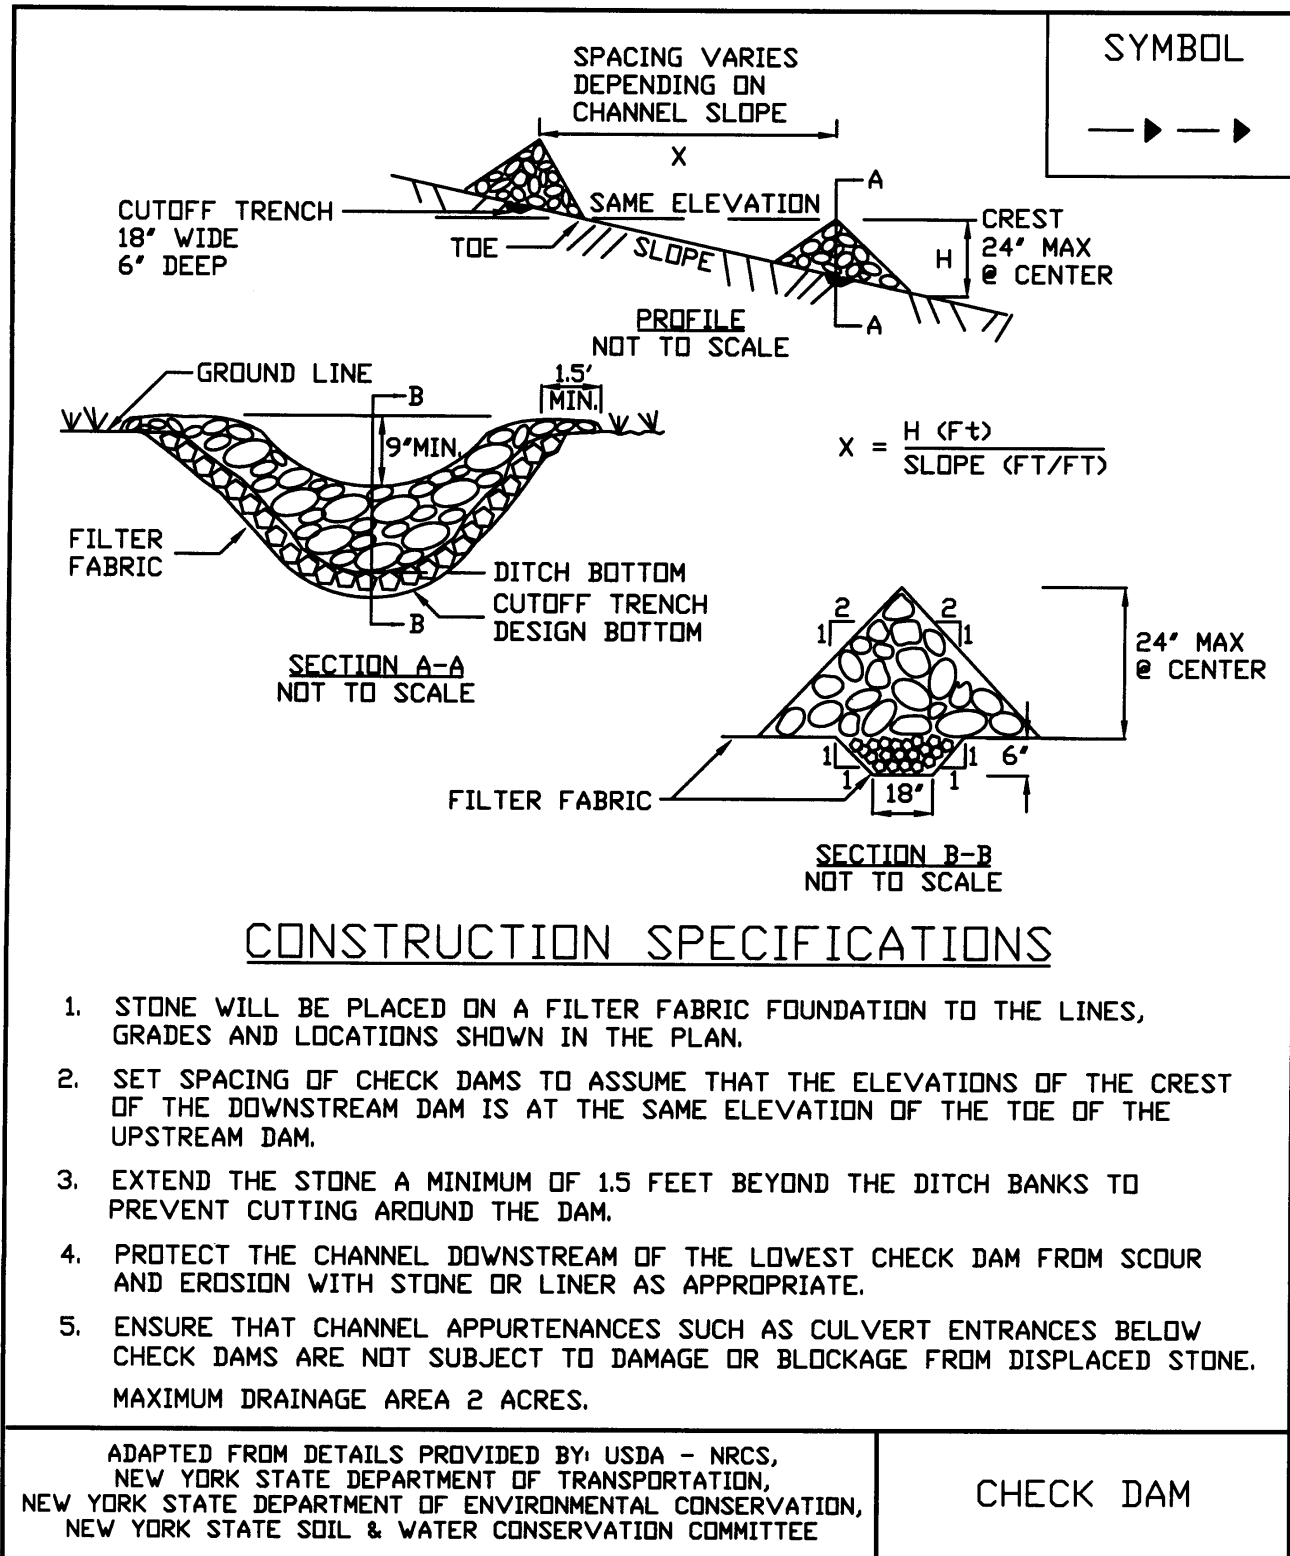

STANDARD AND SPECIFICATIONS FOR STORM DRAIN INLET PROTECTION



Definition

A temporary, somewhat permeable barrier, installed around inlets in the form of a fence, berm or excavation around an opening, trapping water and thereby reducing the sediment content of sediment laden water by settling.

Purpose

To prevent heavily sediment laden water from entering a storm drain system through inlets.

Conditions Where Practice Applies

This practice shall be used where the drainage area to an inlet is disturbed, it is not possible to temporarily divert the storm drain outfall into a trapping device, and watertight blocking of inlets is not advisable. **It is not to be used in place of sediment trapping devices.** This may be used in conjunction with storm drain diversion to help prevent siltation of pipes installed with low slope angle.

Types of Storm Drain Inlet Practices

There are four (4) specific types of storm drain inlet protection practices that vary according to their function, location, drainage area, and availability of materials:

- I. Excavated Drop Inlet Protection
- II. Fabric Drop Inlet Protection
- III. Stone & Block Drop Inlet Protection
- IV. Curb Drop Inlet Protection

Design Criteria

Drainage Area – The drainage area for storm drain inlets shall not exceed one acre. The crest elevations of these practices shall provide storage and minimize bypass flow.

Type I – Excavated Drop Inlet Protection

See details for Excavated Drop Inlet Protection in Figure 5A.11 on page 5A.29.

Limit the drainage area to the inlet device to 1 acre. Excavated side slopes shall be no steeper than 2:1. The minimum depth shall be 1 foot and the maximum depth 2 feet as measured from the crest of the inlet structure. Shape the excavated basin to fit conditions with the longest dimension oriented toward the longest inflow area to provide maximum trap efficiency. The capacity of the excavated basin should be established to contain 900 cubic feet per acre of disturbed area. Weep holes, protected by fabric and stone, should be provided for draining the temporary pool.

Inspect and clean the excavated basin after every storm. Sediment should be removed when 50 percent of the storage volume is achieved. This material should be incorporated into the site in a stabilized manner.

Type II – Fabric Drop Inlet Protection

See Figure 5A.12 for details on Filter Fabric Drop Inlet Protection on page 5A.30.

Limit the drainage area to 1 acre per inlet device. Land area slope immediately surrounding this device should not exceed 1 percent. The maximum height of the fabric above the inlet crest shall not exceed 1.5 feet unless reinforced.

The top of the barrier should be maintained to allow overflow to drop into the drop inlet and not bypass the inlet to unprotected lower areas. Support stakes for fabric shall be a minimum of 3 feet long, spaced a maximum 3 feet apart. They should be driven close to the inlet so any overflow drops into the inlet and not on the unprotected soil. Improved performance and sediment storage volume can be obtained by excavating the area.

Inspect the fabric barrier after each rain event and make repairs as needed. Remove sediment from the pool area as

necessary with care not to undercut or damage the filter fabric. Upon stabilization of the drainage area, remove all materials and unstable sediment and dispose of properly. Bring the adjacent area of the drop inlet to grade, smooth and compact and stabilize in the appropriate manner to the site.

If straw bales are used in lieu of filter fabric, they should be placed tight with the cut edge adhering to the ground at least 3 inches below the elevation of the drop inlet. Two anchor stakes per bale shall be driven flush to bale surface. Straw bales will be replaced every 4 months until the area is stabilized.

Type III – Stone and Block Drop Inlet Protection

See Figure 5A.13 for details on Stone and Block Drop Inlet Protection on page 5A.31.

Limit the drainage area to 1 acre at the drop inlet. The stone barrier should have a minimum height of 1 foot and a maximum height of 2 feet. Do not use mortar. The height should be limited to prevent excess ponding and bypass flow.

Recess the first course of blocks at least 2 inches below the crest opening of the storm drain for lateral support. Subsequent courses can be supported laterally if needed by placing a 2x4 inch wood stud through the block openings perpendicular to the course. The bottom row should have a few blocks oriented so flow can drain through the block to dewater the basin area.

The stone should be placed just below the top of the blocks on slopes of 2:1 or flatter. Place hardware cloth of wire mesh with ½ inch openings over all block openings to hold stone in place.

As an optional design, the concrete blocks may be omitted and the entire structure constructed of stone, ringing the outlet (“doughnut”). The stone should be kept at a 3:1 slope toward the inlet to keep it from being washed into the inlet.

A level area 1 foot wide and four inches below the crest will further prevent wash. Stone on the slope toward the inlet should be at least 3 inches in size for stability and 1 inch or smaller away from the inlet to control flow rate. The elevation of the top of the stone crest must be maintained 6 inches lower than the ground elevation down slope from the inlet to ensure that all storm flows pass over the stone into the storm drain and not past the structure. Temporary diking should be used as necessary to prevent bypass flow.

The barrier should be inspected after each rain event and repairs made where needed. Remove sediment as necessary to provide for accurate storage volume for subsequent rains. Upon stabilization of contributing drainage area, remove all materials and any unstable soil and dispose of properly.

Bring the disturbed area to proper grade, smooth, compact and stabilized in a manner appropriate to the site.

Type IV – Curb Drop Inlet Protection

See Figure 5A. 14 for details on Curb Drop Inlet Protection on page 5A.32.

The drainage area should be limited to 1 acre at the drop inlet. The wire mesh must be of sufficient strength to support the filter fabric and stone with the water fully impounded against it. Stone is to be 2 inches in size and clean. The filter fabric must be of a type approved for this purpose with an equivalent opening size (EOS) of 40-85. The protective structure will be constructed to extend beyond the inlet 2 feet in both directions. Assure that storm flow does not bypass the inlet by installing temporary dikes (such as sand bags) directing flow into the inlet. Make sure that the overflow weir is stable. Traffic safety shall be integrated with the use of this practice.

The structure should be inspected after every storm event. Any sediment should be removed and disposed of on the site. Any stone missing should be replaced. Check materials for proper anchorage and secure as necessary.

STANDARD AND SPECIFICATIONS FOR SEDIMENT TRAP



Definition

A temporary sediment control device formed by excavation and/or embankment to intercept sediment laden runoff and retain the sediment.

Purpose

The purpose of the structure is to intercept sediment-laden runoff and trap the sediment in order to protect drainage ways, properties, and rights-of-way below the sediment trap from sedimentation.

Conditions Where Practice Applies

A sediment trap is usually installed in a drainage way, at a storm drain inlet, or other points of collection from a disturbed area.

Sediment traps should be used to artificially break up the natural drainage area into smaller sections where a larger device (sediment basin) would be less effective.

Design Criteria

If any of the design criteria presented here cannot be met, see Standard and Specification for Sediment Basin on page 5A.49.

Drainage Area

The drainage area for sediment traps shall be in accordance with the specific type of sediment trap used (Type I through V).

Location

Sediment traps shall be located so that they can be installed

prior to grading or filling in the drainage area they are to protect. Traps must not be located any closer than 20 feet from a proposed building foundation if the trap is to function during building construction. Locate traps to obtain maximum storage benefit from the terrain and for ease of cleanout and disposal of the trapped sediment.

Trap Size

The volume of a sediment trap as measured at the elevation of the crest of the outlet shall be at least 3,600 cubic feet per acre of drainage area. The volume of a constructed trap shall be calculated using standard mathematical procedures. The volume of a natural sediment trap may be approximated by the equation: Volume (cu.ft.) = 0.4 x surface area (sq.ft.) x maximum depth (ft.).

Trap Cleanout

Sediment shall be removed and the trap restored to the original dimensions when the sediment has accumulated to ½ of the design depth of the trap. Sediment removed from the trap shall be deposited in a protected area and in such a manner that it will not erode.

Embankment

All embankments for sediment traps shall not exceed five (5) feet in height as measured at the low point of the original ground along the centerline of the embankment. Embankments shall have a minimum four (4) foot wide top and side slopes of 2:1 or flatter. The embankment shall be compacted by traversing with equipment while it is being constructed. The embankment shall be stabilized with seed and mulch as soon as it is completed

The elevation of the top of any dike directing water to any sediment trap will equal or exceed the maximum height of the outlet structure along the entire length of the trap.

Excavation

All excavation operations shall be carried out in such a manner that erosion and water pollution shall be minimal. Excavated portions of sediment traps shall have 1:1 or flatter slopes.

Outlet

The outlet shall be designed, constructed, and maintained in such a manner that sediment does not leave the trap and that erosion at or below the outlet does not occur.

Sediment traps must outlet onto stabilized (preferable undisturbed) ground, into a watercourse, stabilized channel, or into a storm drain system. Distance between inlet and outlet should be maximized to the longest length practicable.

Trap Details Needed on Erosion and Sediment Control Plans

Each trap shall be delineated on the plans in such a manner that it will not be confused with any other features. Each trap on a plan shall indicate all the information necessary to properly construct and maintain the structure. If the drawings are such that this information cannot be delineated on the drawings, then a table shall be developed. If a table is developed, then each trap on a plan shall have a number and the numbers shall be consecutive.

The following information shall be shown for each trap in a summary table format on the plans.

1. Trap number
2. Type of trap
3. Drainage area
4. Storage required
5. Storage provided (if applicable)
6. Outlet length or pipe sizes
7. Storage depth below outlet or cleanout elevation
8. Embankment height and elevation (if applicable)

Type of Sediment Traps

There are five (5) specific types of sediment traps which vary according to their function, location, or drainage area.

- I. Pipe Outlet Sediment Trap
- II. Grass Outlet Sediment Trap
- III. Catch Basin Sediment Trap
- IV. Stone Outlet Sediment Trap
- V. Riprap Outlet Sediment Trap

I. Pipe Outlet Sediment Trap

A Pipe Outlet Sediment Trap consists of a trap formed by embankment or excavation. The outlet for the trap is through a perforated riser and a pipe through the embankment. The outlet pipe and riser shall be made of steel, corrugated metal or other suitable material. The top of the embankment shall be at least 1 ½ feet above the crest of the riser. The top 2/3 of the riser shall be perforated with one (1) inch nominal diameter holes or slits spaced six (6) inches vertically and horizontally placed in the concave portion of the corrugated pipe.

No holes or slits will be allowed within six (6) inches of the top of the horizontal barrel. All pipe connections shall be watertight. The riser shall be wrapped with ½ to ¼ inch hardware cloth wire then wrapped with filter cloth with a sieve size between #40-80 and secured with strapping or

connecting band at the top and bottom of the cloth. The cloth shall cover an area at least six (6) inches above the highest hole and six (6) inches below the lowest hole. The top of the riser pipe shall not be covered with filter cloth. The riser shall have a base with sufficient weight to prevent flotation of the riser. Two approved bases are:

1. A concrete base 12 in. thick with the riser embedded 9 in. into the concrete base, or
2. One quarter inch, minimum, thick steel plate attached to the riser by a continuous weld around the circumference of the riser to form a watertight connection. The plate shall have 2.5 feet of stone, gravel, or earth placed on it to prevent flotation. In either case, each side of the square base measurement shall be the riser diameter plus 24 inches.

Pipe outlet sediment traps shall be limited to a five (5) acre maximum drainage area. Pipe outlet sediment traps may be interchangeable in the field with stone outlet or riprap sediment traps provided that these sediment traps are constructed in accordance with the detail and specifications for that trap.

Select pipe diameter from the following table:

Minimum Sizes

Barrel Diameter ¹ (in.)	Riser Diameter ¹ (in.)	Maximum Drainage Area (ac.)
12	15	1
15	18	2
18	21	3
21	24	4
21	27	5

¹ Barrel diameter may be same size as riser diameter.

See details for Pipe Outlet Sediment Trap ST-I in Figure 5A.16 (1) and 5A.16 (2) on pages 5A.38 and 5A.39.

II. Grass Outlet Sediment Trap

A Grass Outlet Sediment Trap consists of a trap formed by excavating the earth to create a holding area. The trap has a discharge point over natural existing grass. The outlet crest width (feet) shall be equal to four (4) times the drainage area (acres) with a minimum width of four (4) feet. The outlet shall be free of any restrictions to flow. The outlet lip must remain undisturbed and level. The volume of this trap shall be computed at the elevation of the crest of the outlet. Grass outlet sediment traps shall be limited to a five (5) acre maximum drainage area.

STANDARD AND SPECIFICATIONS FOR SEDIMENT BASIN



Class	1	2
Max. Drainage Area (acres)	100	100
Max. Height ¹ of Dam (ft.)	10	15
Min. Embankment Top Width	8	10
Embankment Side Slopes	2:1 or Flatter	2 ½:1 or Flatter
Anti-Seep Control Required	Yes	Yes

¹ Height is measured from the low point of original ground at the downstream toe of the dam to the top of the dam.

Definition

A temporary barrier or dam constructed across a drainage way or at other suitable locations to intercept sediment laden runoff and to trap and retain the sediment.

Scope

This standard applies to the installation of temporary sediment basins on sites where: (a) failure of the structure would not result in loss of life, damage to homes or buildings, or interruption of use or service of public roads or utilities; (b) the drainage area does not exceed 100 acres; and (c) the basin is to be removed within 36 months after the beginning of construction of the basin.

Permanent (to function more than 36 months) sediment basins, or temporary basins exceeding the classification requirements for class 1 and 2, or structures that temporarily function as a sediment basin but are intended for use as a permanent pool shall be classified as permanent structures and shall conform to criteria appropriate for permanent structures. These structures shall be designed and constructed to conform to NRCS Standard And Specification No. 378 for Ponds in the National Handbook of Conservation Practices and the New York State Department of Environmental Conservation, "Guidelines for the Design of Dams." The total volume of permanent sediment basins shall equal to or exceed the capacity requirements for temporary basins contained herein.

Classification of Temporary Sediment Basins

For the purpose of this standard, temporary sediment basins are classified as follows:

Purpose

The purpose of a sediment basin is to intercept sediment-laden runoff and reduce the amount of sediment leaving the disturbed area in order to protect drainage ways, properties, and rights-of-way below the sediment basin.

Conditions Where Practice Applies

A sediment basin is appropriate where physical site conditions or land ownership restrictions preclude the installation of other erosion control measures to adequately control runoff, erosion, and sedimentation. However, it is strongly encouraged to use a basin in addition to other ESC measures if practicable. It may be used below construction operations which expose critical areas to soil erosion. The basin shall be maintained until the disturbed area is protected against erosion by permanent stabilization.

Design Criteria

Compliance with Laws and Regulations

Design and construction shall comply with state and local laws, ordinances, rules and regulations, including permits.

Location

The sediment basin should be located to obtain the maximum storage benefit from the terrain and for ease of cleanout of the trapped sediment. It should be located to minimize interference with construction activities and

STANDARD AND SPECIFICATIONS FOR DUST CONTROL



Definition

The control of dust resulting from land-disturbing activities.

Purpose

To prevent surface and air movement of dust from disturbed soil surfaces that may cause off-site damage, health hazards, and traffic safety problems.

Conditions Where Practice Applies

On construction roads, access points, and other disturbed areas subject to surface dust movement and dust blowing where off-site damage may occur if dust is not controlled.

Design Criteria

Construction operations should be scheduled to minimize the amount of area disturbed at one time. Buffer areas of vegetation should be left where practical. Temporary or permanent stabilization measures shall be installed. No specific design criteria is given; see construction specifications below for common methods of dust control.

Water quality must be considered when materials are selected for dust control. Where there is a potential for the material to wash off to a stream, ingredient information must be provided to the local permitting authority.

Construction Specifications

A. Non-driving Areas – These areas use products and materials applied or placed on soil surfaces to prevent airborne migration of soil particles.

Vegetative Cover – For disturbed areas not subject to traffic, vegetation provides the most practical method of dust control (see Section 3).

Mulch (including gravel mulch) – Mulch offers a fast effective means of controlling dust. This can also include rolled erosion control blankets.

Spray adhesives – These are products generally composed of polymers in a liquid or solid form that are mixed with water to form an emulsion that is sprayed on the soil surface with typical hydroseeding equipment. The mixing ratios and application rates will be in accordance with the manufacturer's recommendations for the specific soils on the site. In no case should the application of these adhesives be made on wet soils or if there is a probability of precipitation within 48 hours of its proposed use. Material Safety Data Sheets will be provided to all applicators and others working with the material.

B. Driving Areas – These areas utilize water, polymer emulsions, and barriers to prevent dust movement from the traffic surface into the air.

Sprinkling – The site may be sprayed with water until the surface is wet. This is especially effective on haul roads and access routes.

Polymer Additives – These polymers are mixed with water and applied to the driving surface by a water truck with a gravity feed drip bar, spray bar or automated distributor truck. The mixing ratios and application rates will be in accordance with the manufacturer's recommendations. Incorporation of the emulsion into the soil will be done to the appropriate depth based on expected traffic. Compaction after incorporation will be by vibratory roller to a minimum of 95%. The prepared surface shall be moist and no application of the polymer will be made if there is a probability of precipitation within 48 hours of its proposed use. Material Safety Data Sheets will be provided to all applicators working with the material.

Barriers – Woven geotextiles can be placed on the driving surface to effectively reduce dust throw and particle migration on haul roads. Stone can also be used for construction roads for effective dust control.

Windbreak – A silt fence or similar barrier can control air currents at intervals equal to ten times the barrier height. Preserve existing wind barrier vegetation as much as practical.

STANDARD AND SPECIFICATIONS FOR STABILIZED CONSTRUCTION ENTRANCE



Definition

A stabilized pad of aggregate underlain with geotextile located at any point where traffic will be entering or leaving a construction site to or from a public right-of-way, street, alley, sidewalk, or parking area.

Purpose

The purpose of stabilized construction entrance is to reduce or eliminate the tracking of sediment onto public rights-of-way or streets.

Conditions Where Practice Applies

A stabilized construction entrance shall be used at all points of construction ingress and egress.

Design Criteria

See Figure 5A.35 on page 5A.76 for details.

Aggregate Size: Use a matrix of 1-4 inch stone, or reclaimed or recycled concrete equivalent.

Thickness: Not less than six (6) inches.

Width: 12-foot minimum but not less than the full width of points where ingress or egress occurs. 24-foot minimum if there is only one access to the site.

Length: As required, but not less than 50 feet (except on a single residence lot where a 30 foot minimum would apply).

Geotextile: To be placed over the entire area to be covered with aggregate. Filter cloth will not be required on a single-family residence lot. Piping of surface water under entrance shall be provided as required. If piping is impossible, a mountable berm with 5:1 slopes will be permitted.

Criteria for Geotextile

The geotextile shall be woven or nonwoven fabric consisting only of continuous chain polymeric filaments or yarns of polyester. The fabric shall be inert to commonly encountered chemicals, hydro-carbons, mildew, rot resistant, and conform to the fabric properties as shown:

Fabric Properties ³	Light Duty ¹	Heavy Duty ²	Test Method
	Roads Grade Subgrade	Haul Roads Rough Graded	
Grab Tensile Strength (lbs)	200	220	ASTM D1682
Elongation at Failure (%)	50	60	ASTM D1682
Mullen Brust Strength (lbs)	190	430	ASTM D3786
Puncture Strength (lbs)	40	125	ASTM D751 modified
Equivalent Opening Size	40-80	40-80	US Std Sieve CW-02215
Aggregate Depth	6	10	--

¹Light Duty Road: Area sites that have been graded to subgrade and where most travel would be single axle vehicles and an occasional multi-axle truck. Acceptable materials are Trevira Spunbond 1115, Mirafi 100X, Tynpar 3401, or equivalent.

²Heavy Duty Road: Area sites with only rough grading, and where most travel would be multi-axle vehicles. Acceptable materials are Trevira Spunbond 1135, Mirafi 600X, or equivalent.


³Fabrics not meeting these specifications may be used only when design procedure and supporting documentation are supplied to determine aggregate depth and fabric strength.

Maintenance

The entrance shall be maintained in a condition which will prevent tracking of sediment onto public rights-of-way or streets. This may require periodic top dressing with additional aggregate. All sediment spilled, dropped, or washed onto public rights-of-way must be removed immediately.

When necessary, wheels must be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with aggregate, which drains into an approved sediment-trapping device. All sediment shall be prevented from entering storm drains, ditches, or watercourses.

Figure 5A.35
Stabilized Construction Entrance

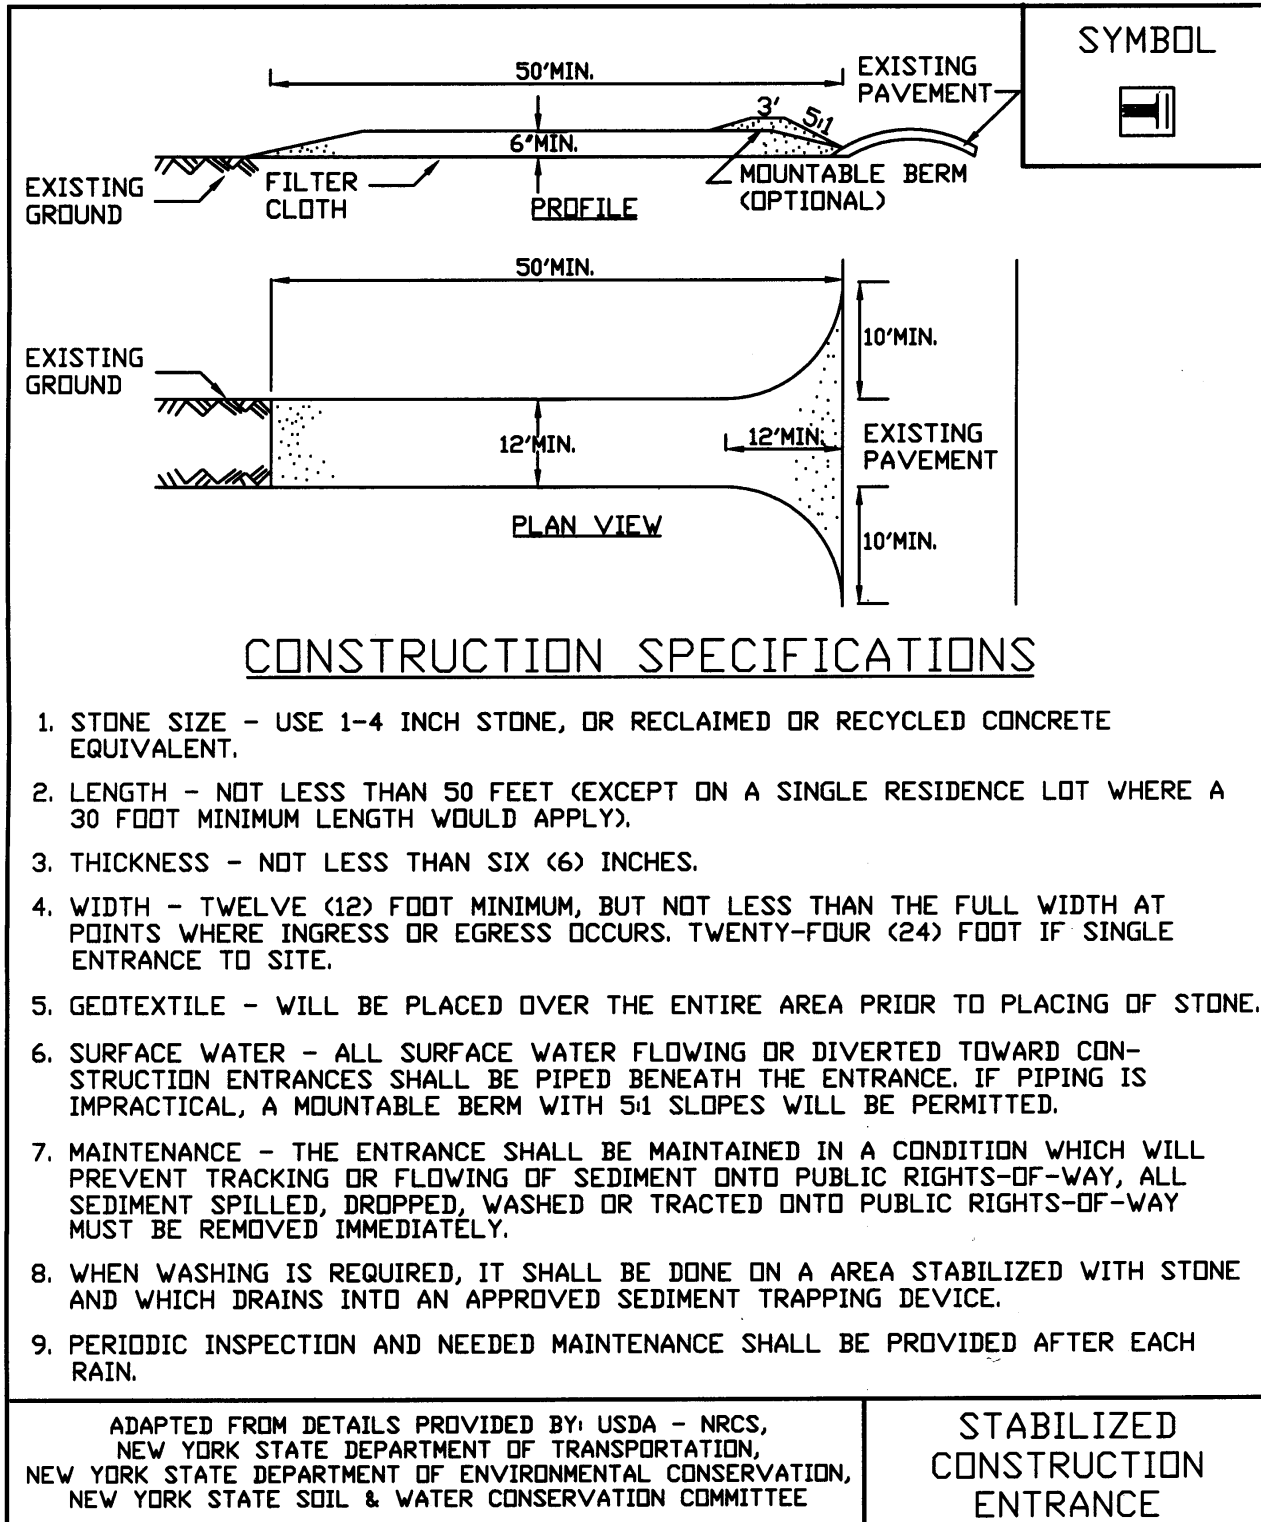

STANDARD AND SPECIFICATIONS FOR GRASSED WATERWAY



Definition

A natural or man-made channel of parabolic or trapezoidal cross-section that is below adjacent ground level and is stabilized by suitable vegetation. The flow channel is normally wide and shallow and conveys the runoff down the slope.

Purpose

The purpose of a grassed waterway is to convey runoff without causing damage by erosion.

Conditions Where Practice Applies

Grass waterways are used where added vegetative protection is needed to control erosion resulting from concentrated runoff.

Design Criteria

Capacity

The minimum capacity shall be that required to confine the peak rate of runoff expected from a 10-year frequency rainfall event or a higher frequency corresponding to the hazard involved. This requirement for confinement may be waived on slopes of less than one (1) percent where out-of-bank flow will not cause erosion or property damage.

Peak rates of runoff values used in determining the capacity requirements shall be computed by [TR-55, Urban Hydrology for Small Watersheds](#), or other appropriate methods.

Where there is base flow, it shall be handled by a stone

center, subsurface drain, or other suitable means since sustained wetness usually prevents adequate vegetative cover. The cross-sectional area of the stone center or subsurface drain size to be provided shall be determined by using a flow rate of 0.1 cfs/acre or by actual measurement of the maximum base flow.

Velocity

Please see Table 5B.1, Diversion Maximum Permissible Design Velocities, for seed, soil, and velocity variables.

Cross Section

The design water surface elevation of a grassed waterway receiving water from diversions or other tributary channels shall be equal to or less than the design water surface elevation in the diversion or other tributary channels.

The top width of parabolic waterways shall not exceed 30 feet and the bottom width of trapezoidal waterways shall not exceed 15 feet unless multiple or divided waterways, stone center, or other means are provided to control meandering of low flows.

Structural Measures


In cases where grade or erosion problems exist, special control measures may be needed such as lined waterways (5B.17), or grade stabilization measures (5B.31). Where needed, these measures will be supported by adequate design computations. For typical cross sections of waterways with riprap sections or stone centers, refer to Figure 5B.8 on page 5B.13.

The design procedures for parabolic and trapezoidal channels are available in the NRCS Engineering Field Handbook; Figure 5B.9 on page 5B.14 also provides a design chart for parabolic waterway.


Outlets

Each waterway shall have a stable outlet. The outlet may be another waterway, a stabilized open channel, grade stabilization structure, etc. In all cases, the outlet must discharge in such a manner as not to cause erosion. Outlets shall be constructed and stabilized prior to the operation of the waterway.

Figure 5B.8
Typical Waterway Cross Sections

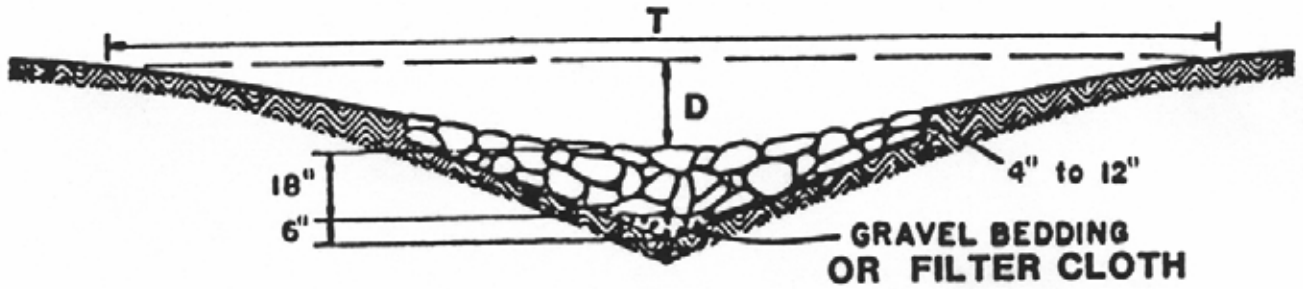


Waterway with stone center drain. "V" section shaped by motor grader.

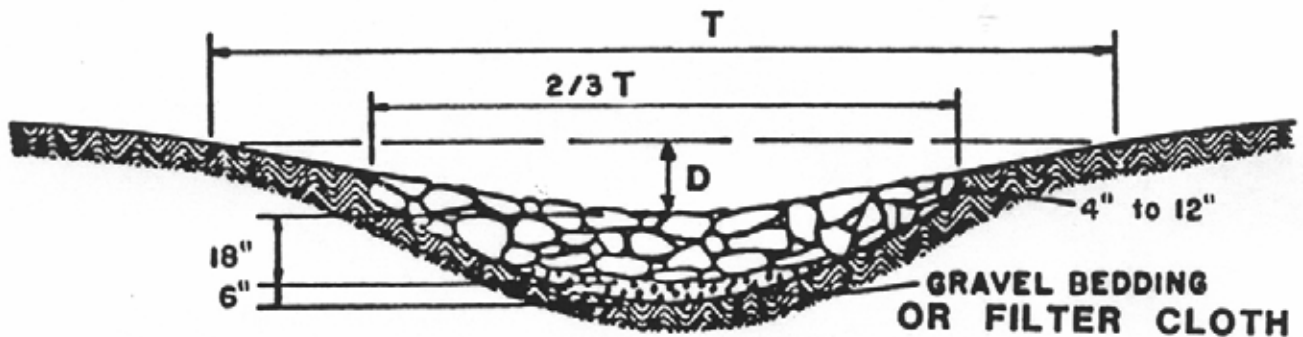

Waterway with stone center drain. Rounded section shaped by bulldozer.

**Figure 5B.10
Grassed Waterway**

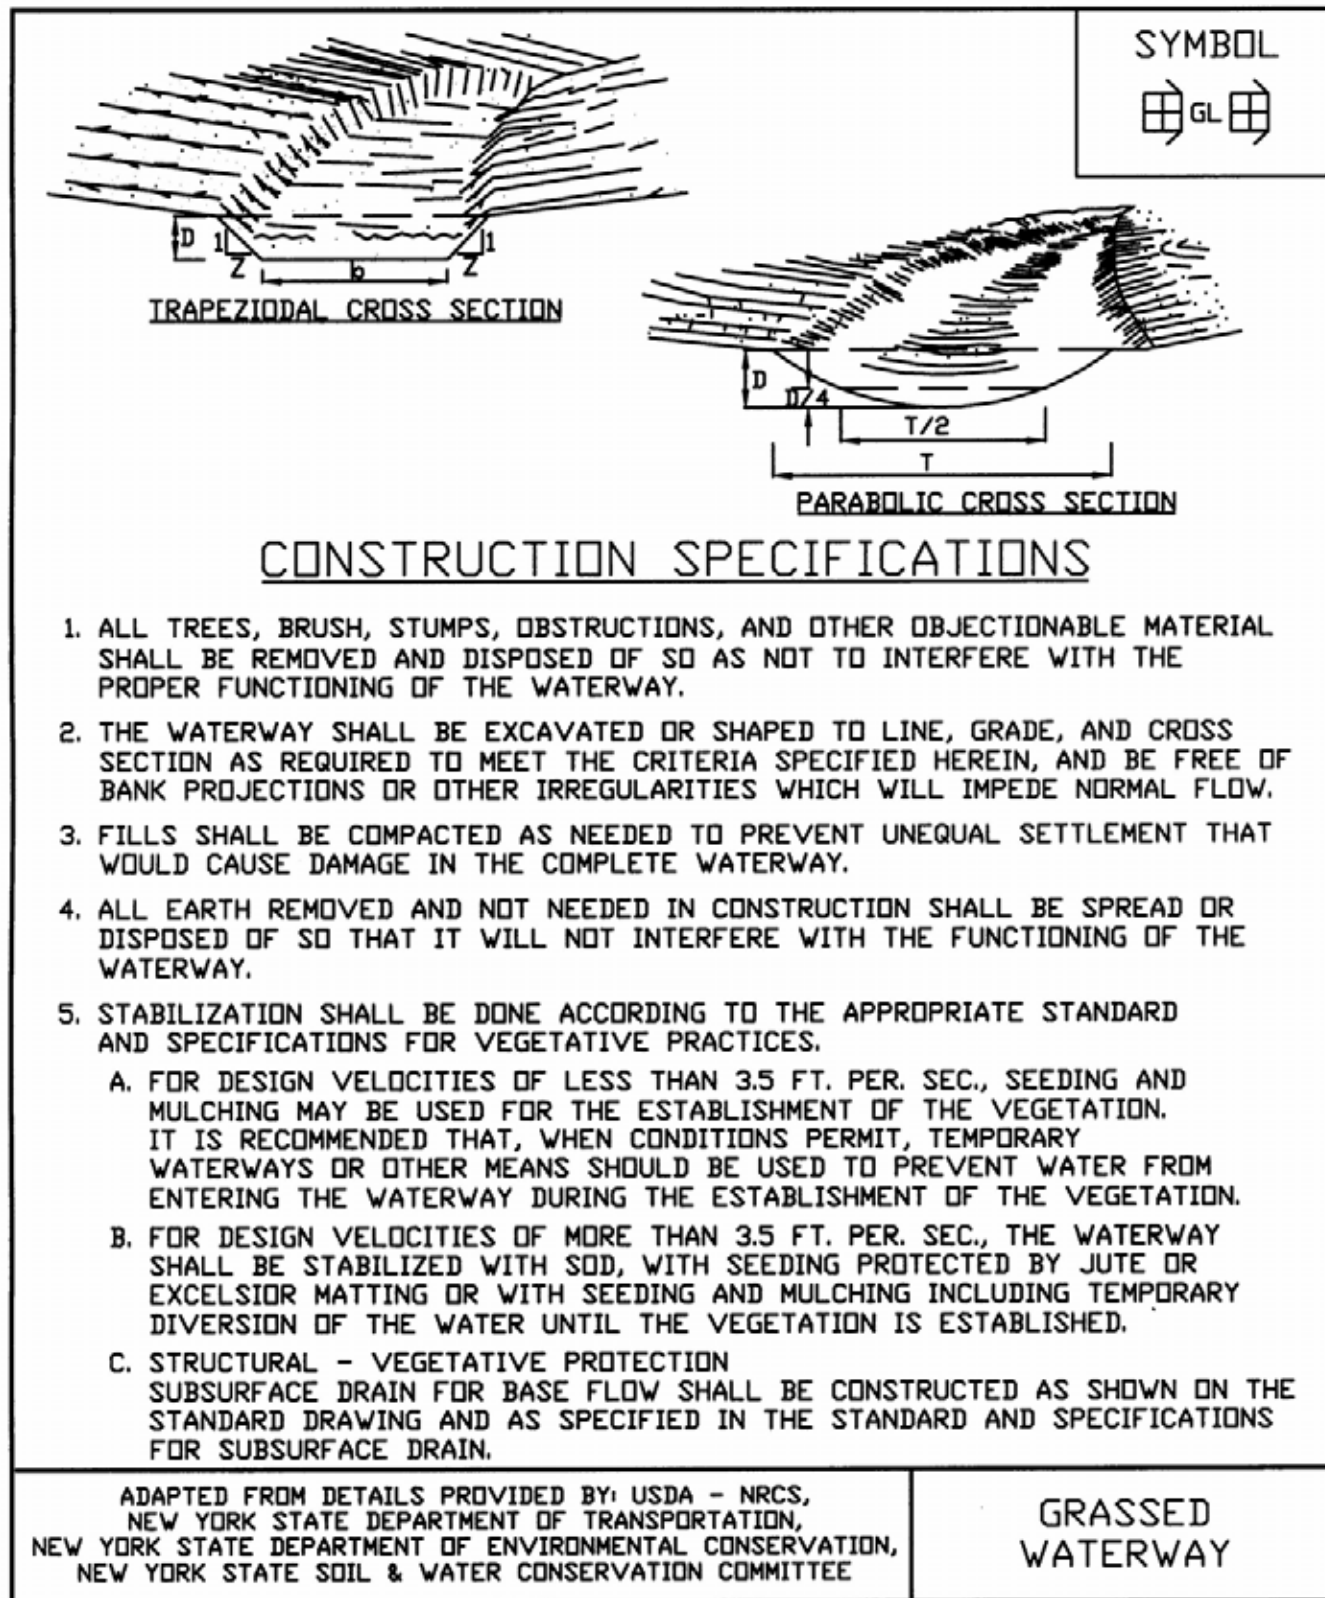

STANDARD AND SPECIFICATIONS FOR LINED WATERWAY OR OUTLET



Definition

A waterway or outlet with a lining of concrete, stone, or other permanent material. The lined section extends up the side slopes to the designed depth. The earth above the permanent lining may be vegetated or otherwise protected.

Purpose

To provide for the disposal of concentrated runoff without damage from erosion or flooding, where grassed waterways would be inadequate due to high velocities.

Scope

This standard applies to waterways or outlets with linings of cast-in-place concrete, flagstone mortared in place, rock riprap, gabions, or similar permanent linings. It does not apply to irrigation ditch or canal linings, grassed waterways with stone centers or small lined sections that carry prolonged low flows, or to reinforced concrete channels. The maximum capacity of the waterway flowing at design depth shall not exceed 100 cubic feet per second.

Conditions Where Practice Applies

This practice applies where the following or similar conditions exist:

1. Concentrated runoff is such that a lining is required to control erosion.
2. Steep grades, wetness, prolonged base flow, seepage, or piping that would cause erosion.

3. The location is such that damage from use by people or animals precludes use of vegetated waterways or outlets.
4. Soils are highly erosive or other soil and climate conditions preclude using vegetation.
5. High value property or adjacent facilities warrant the extra cost to contain design runoff in a limited space.

Design Criteria

Capacity

1. The minimum capacity shall be adequate to carry the peak rate of runoff from a 10-year, 24-hour storm. Velocity shall be computed using Manning's equation with a coefficient of roughness "n" as follows:

<u>Lined Material</u>	<u>"n"</u>
Concrete (Type):	
Trowel Finish	0.015
Float Finish	0.019
Gunitite	0.019
Flagstone	0.022
Riprap	Determine from Figure 5B.11 on page 5B.19
Gabion	0.030

2. Riprap gradation and filter (bedding) are generally designed in accordance with criteria set forth in the National Cooperative Highway Research Program Report 108, available from the University Microfilm International, 300 N. Zeeb Road, Ann Arbor, Michigan 48106, Publication No. PB-00839; or the Hydraulic Engineering Circular No. 11, prepared by the U.S. Bureau of Public Roads, available from Federal Highway Administration, 400 7th Street, S.W., Washington, D.C. 20590, HNG-31, or the procedure in the USDA-NRCS's Engineering Field Manual, Chapter 16.

Velocity

1. Maximum design velocity shall be as shown below. Except for short transition sections, flow with a channel gradient within the range of 0.7 to 1.3 of this